


BX-OWI-1 SENSOR DIMENSION

APPROVAL SHEET

CUSTOMER
PO#
SO#
SHIP DATE
QUANTITY
PRODUCT

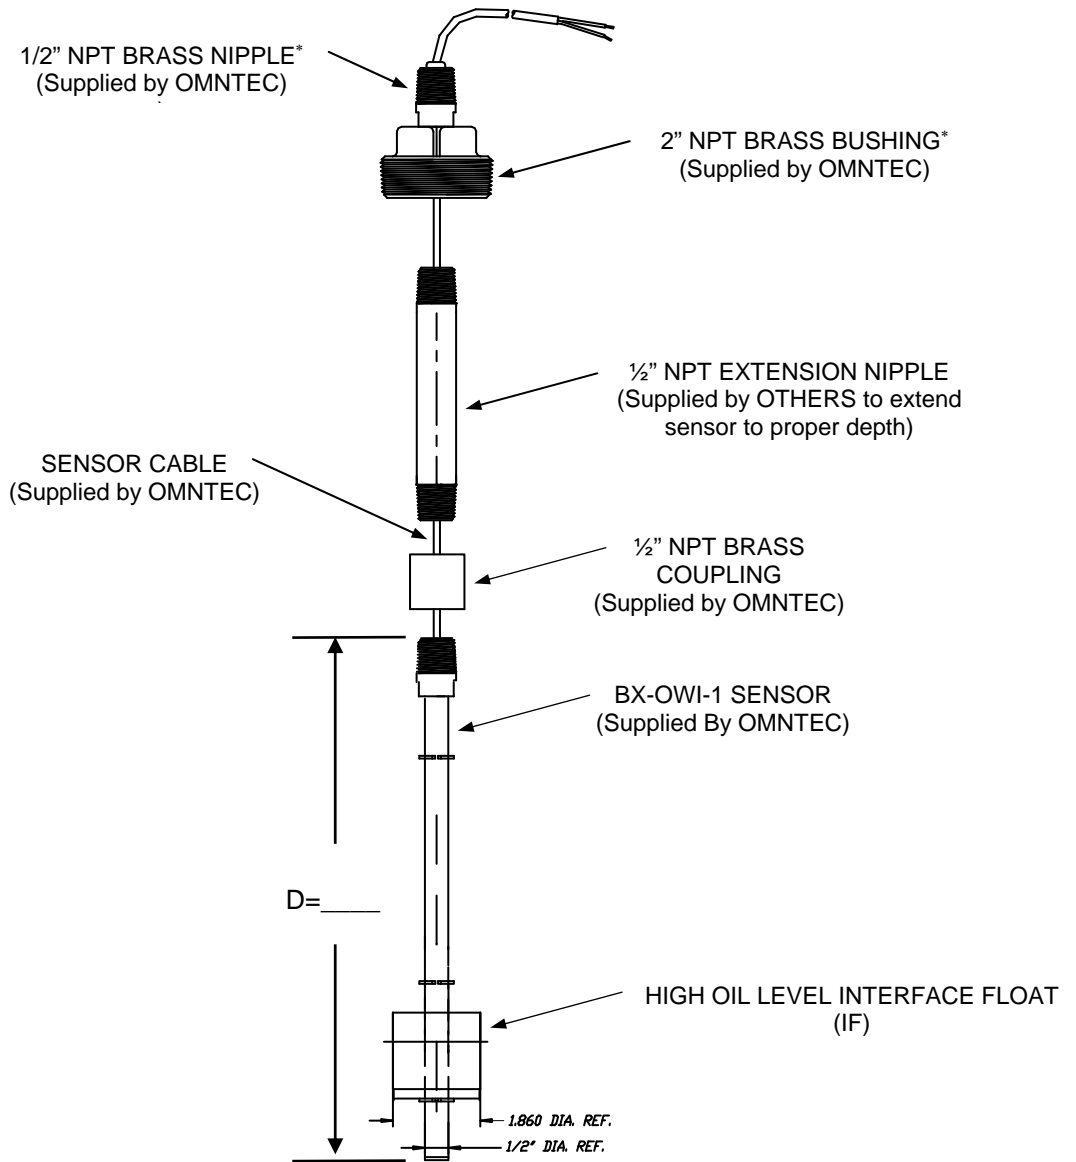

D= dimension For high level in inches*

* Be sure to take into account any riser pipes or manway risers. Dimensions should be calculated from the top of the tank or riser down to the required alarm level(s).

Name: _____
Company: _____
Signature: _____
Date: _____
<i>Signature is required to release product to production</i>